






图 1: T8000-TB20-9JF0触摸屏温控器
Figure 1: T8000-TB20-9JF0 Touch Screen Thermostat






■ 应用

T8000触摸屏温控器适用于中央空调和地板采暖二合一的系统中，夏季开启中央空调，利用现场温度来控制风机盘管的启停，使用户得到舒适的环境。在冬季既可以通过空调内机实现快速风暖制热，也可驱动地暖系统，享受地暖的舒适宁静。

T8000采用微电脑控制技术，大屏幕液晶显示，液晶显示状态有：工作状态（制冷、地暖、制热、地暖+制热、通风）、风机风速、室内温度、设置温度等。采用电容式触摸技术，使操作更加方便，按键有：电源开关（）、模式转换键（）、风速选择键（）、时钟及定时按键（）和温度设置键（）。

■ Application

T8000 Touch Screen Thermostat is applicable to the system of central air-conditioner and floor heating two-in-one. In summer, comfortable environment is reached by controlling the fan coil of air conditioner system with local temperature. In winter, both quick warm air heating from air-conditioner and floor heating are available.

T8000 features with microcomputer control, large LCD screen display, and displays the status of work modes (cooling/floor heating/heating/floor heating&heating/air venting), fan speed, indoor temperature and set temperature etc.. Capacitance touch screen enhances the fluency on operation. Keypad includes: Power on/off () , Mode selection () , Fan Speed selection () , Clock/Timer () and two Adjustment buttons () .

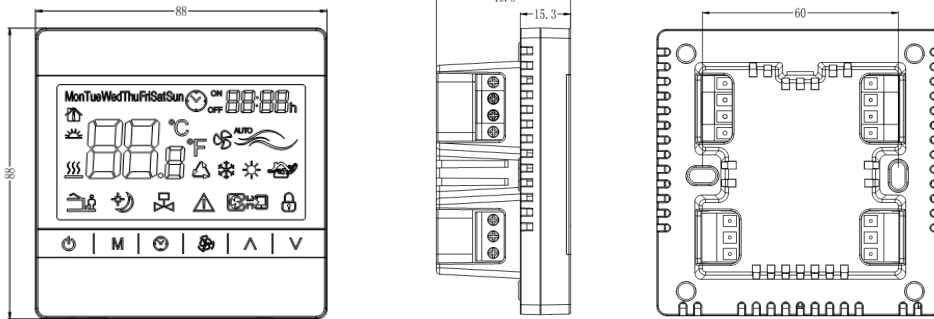


图 2: T8000-TB20-9JF0触摸屏温控器尺寸 (mm)
Figure 2: T8000-TB20-9JF0 Touch Screen Thermostat Dimensions (mm)

■ 安装

T8000温控器安装在用户容易观看屏幕和调节温度设定点的地方。并使温控器位于能代表房间总体环境温度的地方。避免将温控器安装于冷热源附近，如通风口、加热器、室外或阳光照射到的地方。

安装

T8000系列温控器设计为标准75x75x 5mm墙装接线盒安装。（见图3）

按照指示打开后盖底座，把它安装在墙上并接线。

注意：所有T8000系列温控器型号，需要两枚Mx5安装螺钉（盒中自带，如遗失，需采用PWT2.5X5X5.5螺钉）

■ Installation

Install the T8000 where the occupant can read the display and adjust the setpoint easily. Situate the thermostat where the temperature is representative of the general room conditions. Avoid installing the T8000 near cold or warm air drafts, radiant heat, on an outside wall, or in direct sunlight.

Mounting

Mount the T8000 Series thermostat to a 75x75x 5mm standard electrical wallbox. (See Figure 3)

Follow the instructions in removing the base and then proceed to the wall box Mounting and the Wiring sections.

Note: All T8000 Series models require two No. Mx5 mounting screws (Included in the box, screw PWT .5X5X5.5 is required if missing).

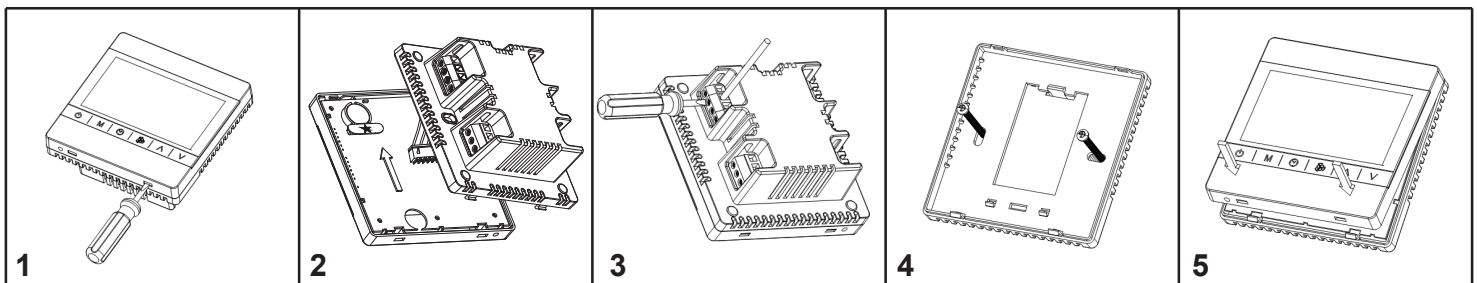


图 3: 安装说明图
Figure 3: Installation diagram

* Remove the insulating strip before installation 请安装前移除绝缘片

注意：给T8000系列温控器接线时，使用接线螺帽完成和绝缘每个接线端。根据接线图4接线

Note: When wiring the T8000 Series Thermostat, use wire nuts to finish and isolate each connection, wire according to Figure 4.

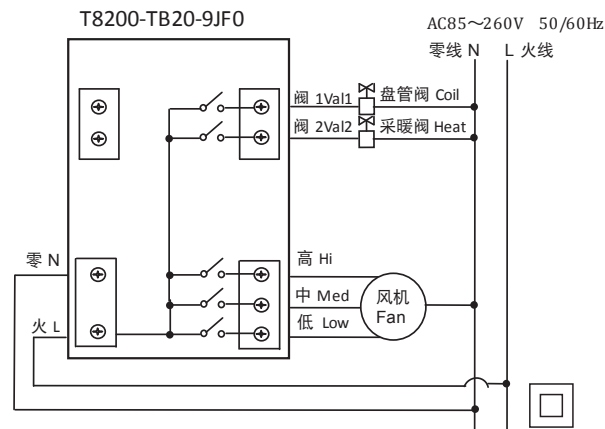












图 4: T8200-TB20-9JF0接线图
Figure 4: Wiring Diagram for T8200-TB20-9JF0

■ 检查步骤

温控器安装完毕, 在离开之前要检查制冷和加热完整的操作循环。这样可以确保所有控制设备功能正常。如果接线正确, 而设备又不能正常工作, 请参考下面故障排除进行简单的检查, 如果温控器显示故障代码或者经过下面故障排除设备依然不能正常工作, 请就近联系Johnson Controls办事处来替换温控器。

■ 使用说明

● **开关机设置:** 按“”键一次开机; 再按一次关机, 同时关闭风机盘管、采暖阀和盘管阀。

● **模式调节:** 在开机状态下, 按“**M**”键进行工作模式切换。液晶显示“”表示制冷, “”表示地暖, 显示“”表示空调制热, 显示“”和“”表示同时开启地暖和空调制热(当设定温度与室内温度差值大于1度, 小于3度时开启地暖, “”闪烁; 当差值大于3度时同时开启地暖和空调, “”和“”同时闪烁), 显示“”表示通风。

● **温度设置:** 在开机状态下, 按“**^**”或“**v**”可进行设置温度的调节, 每次按一次, 温度变化0.5°C。

● **风速调节:**

空调制冷制热模式下操作




温控器有4种风机速度, 自动“”、高“”、中“”、低“”风速。按“”按钮, 将循环显示。






仅风机操作






温控器有3种风机速度, 高“”、中“”、低“”风速。按“”按钮, 将循环显示。

注意: 在地暖模式下, 风机不启动。

● **时钟和定时开关机设置:**

时钟调整: 按“”键, 直至出现“hh:mm”的“mm”闪烁, 按“**^**”或“**v**”键调整分钟。再按“”键, “hh:mm”的“hh”闪烁, 按“**^**”或“**v**”键调整小时。再按“”键, 星期的显示符闪烁, 按“**^**”或“**v**”键调整星期。

定时开关机设置: 开机状态下, 按“”键, 直至出现“hh:mm”、“”、“ON”符号, 并且“”、“ON”闪烁, 按“**^**”或“**v**”键调整, 每次变化30分钟。再按“”键, 直至出现“”、“OFF”符号闪烁, 用上述方法, 设置定时关机的时间。设定一次定时开关机时间只能执行一次, 即只在一天内有效。

取消定时开关机设置: 开机状态下, 按“”键, 直至出现“hh:mm”、“”、“ON”符号, 并且“”、“ON”闪烁, 按“**^**”或“**v**”键调整定时开机的时间调至“00:00”; 再按“”键, 直至出现“”、“OFF”符号闪烁, 用上述方法, 将定时关机的时间调整为“00:00”。

● **按键锁功能:**

锁按键功能: 如果温控器开启了锁按键功能, 在没有人使用的情况下30秒后会自动把按键锁上, 禁止其他人员对温控器进行操作。


按键解锁: 按风速按键5秒即可解锁。(在没有人使用的情况下30秒后会自动把按键锁上)










■ Check-Out Procedure

After the installation, observe the complete operation cycles for cooling and heating control.

This is to make sure that all control devices are functioning correctly. If the device is not working properly and the wiring is correct, the thermostat should be replaced by contacting your nearest Johnson Controls® Representative.

■ Instructions






● **On/Off Setting:** Press “” to turn on, press again to turn off, close the fan and valve.

● **Mode Selection:** Press “**M**” to change the working mode, “” or Cooling, “” for Floor Heating, “” for Air-conditioner Heating, “” & “” for Air-conditioner Heating & Floor Heating (When the difference of Temperature Setting and indoor is over 1°C and below 3°C, Floor heating is turn on and “” blinks; When the difference is over 3°C, Floor heating and Air-conditioner are turn on simultaneously, “” and “” both blink), Vent “”.





● **Temperature Setting:** Press either “**^**” or “**v**” button to increase or decrease by 0.5°C.

● **Fan Speed Adjustment:**

Cooling or Heating Mode Operation




T8000, has 4 speeds fan control: Auto “”, High “”, Middle “”, Low “” fan. Short press the “” button switches through the sequence.






Fan only Operation






T8000, has 3 speeds fan control; High “”, Middle “”, Low “” fan. Short press the “” button switches through the sequence.

Note: Fan stops at Floor Heating Mode.

● **Time Adjustment and Time-On/Off Operation:**

Time Adjustment: Continuously press “” button until “mm” in “hh:mm” blinks, then press “**^**” or “**v**” to adjust the minute. Press “” button again until “hh” in “hh:mm” blinks, then press “**^**” or “**v**” to adjust the hour. Press “” button again and adjust the weekday by the same method.

Time-On/Off Operation: Continuously press “” button until the “hh:mm”, “”, “ON” appear, and “”, “ON” blink. Press either “**^**” or “**v**” key to adjust the Time-On by 30 minutes. Press “” button again until “”, “OFF” blink. Then adjust the Time-Off by the same method. Time-On/Off setting performs only once within one day.

Time-On/Off Cancel: Continuously press “” button until the “hh:mm”, “”, “ON” appear, and “”, “ON” blink. Press either “**^**” or “**v**” key to adjust the Time-On “00:00”. Press “” button again until “”, “OFF” blink. Then adjust the Time-Off “00:00” by the same method.

● **Lock function:**

Lock function: If Lock function is enabled, the thermostat will be locked automatically after 30 seconds unused.

Unlock function: Hold down the fan key 5 seconds to unlock.

• 计时功能:

在开机状态下, 长按“⌚”键5S, 此时进入计时界面, 此时显示的时间为温控器累计运行的时间。

在关机状态下, 长按“⌚”键10S, 进入计时界面, 此时按“⌚”键可以将累计时间清零。

• 低温保护功能:

温控器处于关机状态, 当室内温度低于5℃时, 温控器自动开启制热并显示“☀️”符号, 同时打开采暖阀和盘管阀, 风机高速运行; 当室内温度升高到7℃时, 温控器自动关闭输出。

• 待机功能:

当没有按键操作情况下, 30S后进入待机界面, 背光变为微亮, 此时按下任意按键, 退出待机界面同时背光变亮。

Function / 功能	Function / 功能
Cool Mode / 制冷模式	❄️
Heat Mode / 加热模式	☀️
Fan only Mode / 仅风机	🌀
Floor heating / 地板采暖	🔥

• Timer Function:

On power on status, hold the "⌚" button for 5s to enter the Timer interface, where the thermostat's accumulated running time is showing.

On power off status, hold the "⌚" button for 10s to enter the Timer interface, accumulated running time can be cleared by pressing "⌚".

• Low Temperature protection Function:

On power Off status and when room temperature is lower than 5℃, heat function will be automatically switched on, "☀️" appears, the heating valve and coil are opened, and the fan is set to HI-speed. When the room temperature reaches 7℃, the setting will be automatically canceled.

• Standby Function:

The thermostat will change to standby interface after 30 seconds no pressed, and backlight becomes slightly bright. Quit the standby interface by pressing any key and backlight becomes normal again.

参数设定:

Parameter Setting:

关机状态下, 同时按住“⌚”键和“^”键5秒, 即可进入参数设置界面, 此界面下, 按“M”键循环选择需要设定的参数, 按“^”或“V”键调节参数。参数明细表如下:
(调整时一定要慢些进行, 尤其在按“M”键时, 不能在一秒钟内按一次以上)

On power off status, hold the "⌚" and "^" keys for 5 seconds to enter parameter setting interface. Press "M" key to select the parameter, and then adjust it by "^" or "V" key. Setting table is as following: (note to operate slowly, especially keep over 1 second interval between each "M" key pressing)

参数项 Code	参数名 Parameter	默认值 Default	功能含义 Function
01	失电重启 Restart after Power Failure	00	00: 关闭; 01: 开启; 02: 恢复掉电前状态; 00: off; 01: on; 02: keep last status
02	摄氏华氏转换 °F/°C	°C	F: 华氏度 (°F); C: 摄氏度 (°C) F: Fahrenheit Degree (°F); C: Celsius Degree (°C)
03	设定温度上限 Upper limit of set temp	35.0°C	设定范围2~49.5°C (4-99°F) Setting Range 2~49.5°C (4-99°F)
04	设定温度下限 Lower limit of set temp	5.0°C	设定范围0~47.5°C (0-95°F) Setting Range 0~47.5°C (0-95°F)
05	键盘锁 Keypad lockout	00	00: 无锁; 01: 锁定所有键; 02: 锁定除风速键和上下键外其他键; 03: 锁定开关键和时钟键。 00: No lock; 01: Lock all keys; 02: Lock the keys except Fan Speed and Temp Adjustment keys; 03: Lock the ON/OFF and Clock keys
06	屏幕显示 Screen Display	00	00: 显示室内温度; 01: 显示设定温度 00: Display room temp; 01: Display set temp
07	低温保护 Low Temperature protection	00	00: 关闭; 01: 开启 00: off; 01: on
08	温度校准 Temperature differential	00	设定范围-5~5°C (-9-9°F) Setting Range -5~5°C (-9-9°F)

■ 标定

T8000系列温控器不需要现场标定。

■ Calibration

No on-site calibration required for the T8000 series thermostat.

■ 故障检修

■ Troubleshooting

故障现象	解决方法
温控器不开机	1. 检查接线是否正常 2. 检查保险是否脱落 3. 检查前后面板排线是否安装到位 4. 检查AC220电源是否供电正常

Troubles	Solutions
The thermostat cannot be powered on	1. Check the wire connection 2. Check if the insure fall off 3. Check if the front/back panel is installed correctly 4. Check if the AC220 power is normally supplied

故障显示代码说明

传感器出现故障，温控器关闭风机和电动阀，并显示“△”以及“E1”“E2”“EE”。

E1: 传感器短路报警。

E2: 传感器断路报警。

EE: E²故障时显示。

当温度高于55°C显示“HI”，当温度低于0°C显示“LO”。

维修和替换

不要试图现场维修T8000系列温控器。如果温控器不能正常工作，请于附近Johnson Controls办事处联系。当联系办事处更换产品的时候，请说明外部标签或参数表上印有的类型/型号。

技术参数

请参考产品说明书。

重要:

- T8000系列温控器仅用作在线电压风机盘管控制使用。当T8000系列温控器调节装置失灵或故障时可能会导致人员伤亡，财产损失及其它设备损坏。增加预防措施，如常使用监控及报警系统、电压保护开关等，在安装系统中。来加强此温度调节装置的机能失常和失效时的保护。
- 不要把温控器装在结露、潮湿或有湿气处。湿气会损坏温控器。
- 不要把封入前盖的PCB板移出，从前盖中把封入的PCB板拆卸移出将不再享有质保服务。
- 使所有接线符合国家、地区和当地的规定。不要超过T8000系列温控器电流容量。



警告:

- 在进行电器接线时确保电源断开。在带电时连接各部件可能引起电击，从而导致人员伤亡甚至死亡。
- 电击危险
按照国家、地区和当地的规定给温控器接地。接地失效可能导致电击和人员伤亡甚至死亡。
- 电击危险和财物损坏
在温控器通电前把未使用的线头保护好，使之绝缘。任何一个未使用的线头未被绝缘和保护可能导致财产损失，电击和人员伤亡甚至死亡。



注意:

在所有的接线未检查好之前，不要给系统通电。短路或不正确的接线可能导致设备永久性的损坏。

Fault Alarm

When the sensor is in fault, thermostat will close the fan and valve, and display "△", "E1", "E2" and "EE".

E1: Sensor short cut alarm

E2: Sensor circuit breaker alarm

EE: E² fault alarm

Display "HI", temperature > 55°C; display "LO", temperature < 0°C

Repair and Replacement

Do not attempt to repair the T8000 Series thermostat. In case of an improperly functioning control, contact the nearest Johnson Controls® representative, and specify the desired product code number. When contacting the supplier for a replacement please state the type/model number of the control located on the data plate or cover label.

Specifications

Refer to Product Catalog for Details.

IMPORTANT:

- Use this T8000 Series Line Voltage Fan Coil Thermostat only as an operating control. Where failure of malfunction of the T8000 Series Thermostat could lead to personal injury or property damage to the controlled equipment or other property, additional precautions must be designed into the system. Incorporate and maintain other devices such as supervisory or alarm systems or safety or limit controls intended to warn of, or protect against, failure or malfunction of the T8000 Series Thermostat.
- Do not install this thermostat in condensing, wet, or damp environments. Moisture may cause damage to the thermostat.
- Do not remove PCB from the enclosure cover. Removing the PCB from the enclosure cover voids the product warranty.
- Make all wiring connections in accordance with local, nation, and regional regulations. Do not exceed the T8000 Series thermostat's electrical ratings.



WARNING:

- Disconnect power supply before making electrical connections. Contact with components carrying hazardous voltages can cause electrical shock and may result in severe personal injury or death.
- Risk of Electrical Shock
Ground the thermostat according to local, national, and regional regulations. Failure to ground the thermostat may result in electrical shock and severe personal injury and death.
- Risk of Electrical Shock and Property Damage
Insulate and secure each unused wire lead before applying power to the thermostat. Failure to insulate and secure each unused wire lead may result property damage, electrical shock, and severe personal injury or death.



CAUTION:

Do not apply power to the system before checking all wiring connections. Short circuited or improperly connected wires may result in permanent damage to the equipment.